


Sidewalk and Driveway with Planting Strip

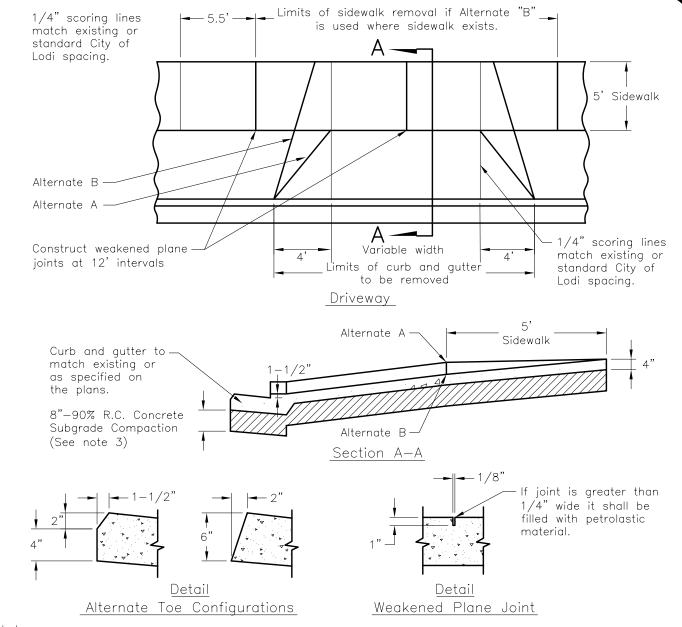

Notes:

- 1. Alternate "A" shall be used, except where the driveway slope approaches 3 inches per foot. It may then be necessary to use Alternate "B".
- 2. When Alternate "B" is used sidewalk shall be removed to nearest score—mark by sawing. When the sidewalk is replaced the existing scoring pattern shall be maintained.
- 3. Additional compaction is not required where existing curb and gutter, sidewalk, and/or driveway are being removed and replaced.
- 4. Class B concrete per Section 90 of Std. Specs, 1-1/2" max. aggregate with impervious membrane cure and light broom finish.

D	r. _K	No.	Date	Revision	Appr.	Approved By:/	STD PLAN
_		1	9/25	ADDED SCORE LINES		1 / /	318 1 2/11
С	h. WS					F. Wally Sandelin 9/25/02	1 101
	ate					F. Wally Sandelin Date	_
	12/00					R.Č.E. 39895	